

# OPERATOR'S MANUAL PX01X-XXX-XXX-AXXX

INCLUDING: OPERATION, INSTALLATION AND MAINTENANCE

RELEASED: 3-7-13

REVISED: 09-26-25

(REV: P)

## 1/4" DIAPHRAGM PUMP

1:1 RATIO (NON-METALLIC)



**READ THIS MANUAL CAREFULLY BEFORE INSTALLING,  
OPERATING OR SERVICING THIS EQUIPMENT.**

It is the responsibility of the employer to place this information in the hands of the operator. Keep for future reference.

### PUMP DATA

**Models**..... see Model Description Chart on page 2 for  
“-XXX” options

**Pump Type**.. Non-Metallic Air Operated Double Diaphragm

**Material**..... see Model Description Chart

**Weight**..... Polypropylene..... 2.86 lbs (1.30 kgs)

PVDF..... 3.88 lbs (1.76 kgs)

Acetal..... 3.52 lbs (1.60 kgs)

**Maximum Air Inlet Pressure** ..... 125 psig (8.6 bar)

**Minimum Air Inlet Pressure**..... 10 psig (0.69 bar)

**Maximum Outlet Pressure** ..... 125 psig (8.6 bar)

**Maximum Flow Rate** ..... 5.3 gpm (20 lpm)

**Maximum Material Inlet Pressure**... 10 psig (0.69 bar)

**Displacement / Cycle @ 125 psig**.... 0.019 gal / 0.072 ltrs

**Maximum Particle Size** ..... 1/16" dia. (1.6 mm)

**Maximum Temperature Limits**

(diaphragm / ball / seat material)

Acetal..... -20° to 180° F (-29° to 82° C)

E.P.R. / EPDM..... -60° to 280° F (-51° to 138° C)

PVDF..... 10° to 200° F (-12° to 93° C)

Hytrel®..... -20° to 180° F (-29° to 82° C)

Neoprene..... 0° to 200° F (-18° to 93° C)

Nitrile®..... 10° to 180° F (-12° to 82° C)

Polypropylene..... 32° to 175° F (0° to 79° C)

Viton®..... -40° to 350° F (-40° to 177° C)

Santoprene®..... -40° to 225° F (-40° to 107° C)


PTFE..... 40° to 225° F (4° to 107° C)

**Dimensional Data**..... see page 14


**Noise Level @ 70 psig, 60 cpm**..... 62.3 dB(A)①

① The pump sound pressure levels published here have been updated to an Equivalent Continuous Sound Level (LA<sub>eq</sub>) to meet the intent of ANSI S1.13-2005, CAGI-PNEUROP S5.1.

Mounting Adapter Plate Optional Accessory Kit (24123879) available.  
Please contact your nearest **ARO** customer service or distributor for details.

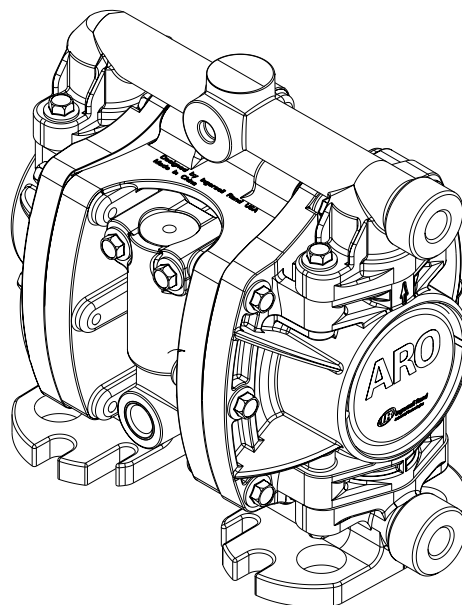

**Model PD01X**

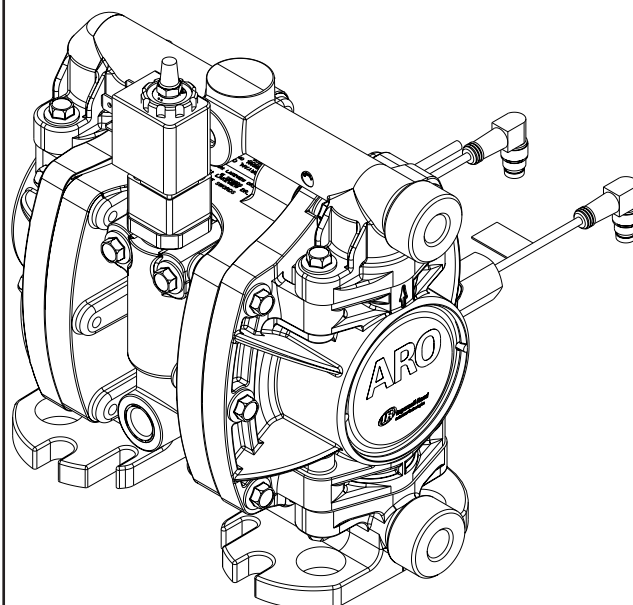

**Model PE01X**

**Figure 1**

**ARO**

209 NORTH MAIN STREET – BRYAN, OHIO 43506

① (800) 495-0276 • FAX (800) 892-6276

© 2025

CCN 80448053

arozone.com

**ARO®**

# MODEL DESCRIPTION CHART

## Model Code Explanation

### Example:

PX01

X

-

X

X

X

-

X

X

X

-

A

X

X

X

### Model Series

PD01- Standard Pump

PE01- Electronic Interface

### Center Body Material

E- Groundable Polypropylene (★)

P- Polypropylene

### Connection

H- Hybrid 1/4" NPT / BSP

### Fluid Caps / Manifold Material

D- Groundable Acetal (★)

E- Groundable Acetal (Multiple port) (★)

K- PVDF

L- PVDF (Multiple port)

P- Polypropylene

R- Polypropylene (Multiple port)

### Hardware Material

S- Stainless Steel

### Seat / Spacer Material

D- Acetal

K- PVDF

P- Polypropylene

O- Polypropylene (Flex Check Spacer)

1- Acetal (Flex Check Spacer)

2- PVDF (Flex Check Spacer)

### Check Material

A- Santropene

C- Hytrel

G- Nitrile

J- Nitrile (flex check only)

K- EPR (flex check only)

L- Viton (flex check only)

N- Neoprene (flex check only)

T- PTFE

### Diaphragm / O-Ring Material

A- Santoprene

C- Hytrel

G- Nitrile

T- PTFE

### Revision

A- Revision

### Specialty Code 1 (Blank if no Specialty Code)

A- Solenoid 120 VAC, 110 VAC and 60 VDC

B- Solenoid 12 VDC, 24 VAC and 22 VAC

C- Solenoid 240 VAC, 220 VAC and 120 VDC

D- Solenoid 24 VDC, 48 VAC and 44 VAC

E- Solenoid 12 VDC NEC/CEC (★)

F- Solenoid 24 VDC NEC/CEC (★)

G- Solenoid 12 VDC ATEX/IECEx (★)

H- Solenoid 24 VDC ATEX/IECEx (★)

J- Solenoid 120 VAC NEC/CEC (★)

K- Solenoid 220 VAC ATEX/IECEx (★)

N- Solenoid with no Coil (★)

O- Standard Valve Block (No Solenoid) (★)

### Specialty Code 2 (Blank if no Specialty Code)

E- End of Stroke feedback + Leak Detection

F- End of Stroke feedback

G- End of Stroke ATEX/IECEx (★)

H - End of Stroke + Leak Detection ATEX/IECEx (★)

L- Leak Detection

M - Leak Detection ATEX/IECEx / NEC/CEC (★)

R- End of Stroke Feedback NEC/CEC (★)

T- End of Stroke Feedback + Leak Detection NEC/CEC (★)

O- No option

### Special Testing

For Special Testing options, please contact your nearest ARO Customer Service Representative or Distributor.

**NOTICE: All possible options are shown in the chart, however, certain combinations may not be recommended.**

**Consult a representative or the factory if you have questions concerning availability.**

(★) Only options indicated with an asterisk (★) are acceptable for use in hazardous locations, however, certain combinations are not possible.

## OPERATING AND SAFETY PRECAUTIONS

READ, UNDERSTAND, AND FOLLOW THIS INFORMATION TO AVOID INJURY AND PROPERTY DAMAGE



**⚠ WARNING** EXCESSIVE AIR PRESSURE. Can cause personal injury, pump damage or property damage.

- Do not exceed the maximum inlet air pressure as stated on the pump model plate.
- Be sure material hoses and other components are able to withstand fluid pressures developed by this pump. Check all hoses for damage or wear. Be certain dispensing device is clean and in proper working condition.

**⚠ WARNING** STATIC SPARK. Can cause explosion resulting in severe injury or death. Ground pump and pumping system.

- PX01X-HDS-XXX are Groundable Acetal pumps: Use the pump ground lug provided. Connect to a 12 ga. (minimum) wire (kit 66885-1 is included) to a good earth ground source.
- Sparks can ignite flammable material and vapors.
- The pumping system and object being sprayed must be grounded when it is pumping, flushing, recirculating or spraying flammable materials such as paints, solvents, lacquers, etc. or used in a location where surrounding atmosphere is conducive to spontaneous combustion. Ground the dispensing valve or device, containers, hoses and any object to which material is being pumped.
- Secure pump, connections and all contact points to avoid vibration and generation of contact or static spark.
- Consult local building codes and electrical codes for specific grounding requirements.
- After grounding, periodically verify continuity of electrical path to ground. Test with an ohmmeter from each component (e.g., hoses, pump, clamps, container, spray gun, etc.) to ground to insure continuity.
  - For "intrinsically safe" applications: ohmmeter should show less than 1 ohm.
  - For "ordinary" applications: ohmmeter should show less than 5 ohms.
  - Pump components surface resistance: materials are generally considered conductive with resistance less than  $1 \times 10^6$  ohms.
- Submerge the outlet hose end, dispensing valve or device in the material being dispensed if possible. (Avoid free streaming of material being dispensed.)
- Use hoses incorporating a static wire.
- Use proper ventilation.
- Keep inflammables away from heat, open flames and sparks.
- Keep containers closed when not in use.

**⚠ WARNING** Pump exhaust may contain contaminants. Can cause severe injury. Pipe exhaust away from work area and personnel.

- In the event of a diaphragm rupture, material can be forced out of the air exhaust muffler.
- Pipe the exhaust to a safe remote location when pumping hazardous or inflammable materials.
- Use a grounded 1/4" minimum ID hose between the pump and the muffler.

**⚠ WARNING** HAZARDOUS PRESSURE. Can result in serious injury or property damage. Do not service or clean pump, hoses or dispensing valve while the system is pressurized.

- Disconnect air supply line and relieve pressure from the system by opening dispensing valve or device and / or carefully and slowly loosening and removing outlet hose or piping from pump.

**⚠ WARNING** HAZARDOUS MATERIALS. Can cause serious injury or property damage. Do not attempt to return a pump to the factory or service center that contains hazardous material. Safe handling practices must comply with local and national laws and safety code requirements.

- Obtain Material Safety Data Sheets on all materials from the supplier for proper handling instructions.

**⚠ CAUTION** Verify the chemical compatibility of the pump wetted parts and the substance being pumped, flushed or recirculated. Chemical compatibility may change with temperature and concentration of the chemical(s) within the substances being pumped, flushed or circulated. For specific fluid compatibility, consult the chemical manufacturer.

**⚠ CAUTION** Maximum temperatures are based on mechanical stress only. Certain chemicals will significantly reduce maximum safe operating temperature. Consult the chemical manufacturer for chemical compatibility and temperature limits. Refer to PUMP DATA on page 1 of this manual.

**⚠ CAUTION** Be certain all operators of this equipment have been trained for safe working practices, understand it's limitations, and wear safety goggles / equipment when required.

**⚠ CAUTION** Do not use the pump for the structural support of the piping system. Be certain the system components are properly supported to prevent stress on the pump parts.

- Suction and discharge connections should be flexible connections (such as hose), not rigid piped, and should be compatible with the substance being pumped.

**⚠ CAUTION** Prevent unnecessary damage to the pump. Do not allow pump to operate when out of material for long periods of time.

- Disconnect air line from pump when system sits idle for long periods of time.

**⚠ CAUTION** Use only genuine ARO® replacement parts to assure compatible pressure rating and longest service life.

**NOTICE** Install the pump in the vertical position. The pump may not prime properly if the balls do not check by gravity upon start-up.

**NOTICE** RE-TORQUE ALL FASTENERS BEFORE OPERATION. Creep of housing and gasket materials may cause fasteners to loosen. Re-torque all fasteners to insure against fluid or air leakage.

**NOTICE** Replacement warning labels are available upon request: Static Spark" pn \ 93616-1, Diaphragm Rupture" pn \ 93122.

<b>⚠ WARNING</b>	= Hazards or unsafe practices which could result in severe personal injury, death or substantial property damage.
<b>⚠ CAUTION</b>	= Hazards or unsafe practices which could result in minor personal injury, product or property damage.
<b>NOTICE</b>	= Important installation, operation or maintenance information.

## GENERAL DESCRIPTION

The ARO diaphragm pump offers high volume delivery even at low air pressures, easy self priming and the ability to pump various viscosity materials. The pump is designed to correspond to the needs of the user by offering a variety of wetted parts configurations to handle almost any application.

Air operated double diaphragm pumps utilize a pressure differential in the air chambers to alternately create suction and positive fluid pressure in the fluid chambers. Flat checks insure a positive flow of fluid.

Pump cycling will begin as air pressure is applied and it will continue to pump and keep up with the demand. It will build and maintain line pressure and will stop cycling once maximum line pressure is reached (dispensing device closed) and will resume pumping as needed.

The Acetal material used in this pump contains stainless steel fibers. It's conductivity allows it to be connected to a suitable ground. A ground screw is provided for this.

## AIR AND LUBE REQUIREMENTS

**⚠ WARNING EXCESSIVE AIR PRESSURE. Can cause pump damage, personal injury or property damage.**

- A filter capable of filtering out particles larger than 50 microns should be used on the air supply. In most applications there is no lubrication required other than the "O" ring lubricant which is applied during assembly or repair.
- The pump, when fitted with flex checks, can be rotated 360° to suit the application. It may be mounted upside down or on the wall with no effect on suction lift or operating efficiency. The filter and regulator need to be oriented in a normal vertical direction to function properly.
- If lubricated air is present, make sure that it is compatible with the "O" rings and seals in the air motor section of the pump.

## INSTALLATION

- Apply PTFE tape or pipe sealant to threads upon assembly to prevent leakage.
- Secure the diaphragm pump legs to a suitable surface to insure against damage by vibration.
- When the diaphragm pump is used in a forced-feed (flooded inlet) situation, it is recommended that a "Check Valve" be installed at the air inlet.

## OPERATING INSTRUCTIONS

- Always flush the pump with a solvent compatible with the material being pumped if the material being pumped is subject to "setting up" when not in use for a period of time.
- Disconnect the air supply from the pump if it is to be inactive for a few hours.
- The outlet material volume is governed not only by the air supply, but also by the material supply available at the inlet. The material supply tubing should not be too small or restrictive. Be sure not to use hose which might collapse.

## MAINTENANCE

- This product is not intended to be repairable. However, some service items are available.
- Provide a clean work surface to protect sensitive internal moving parts from contamination from dirt and foreign matter during service disassembly and reassembly.
- Keep good records of service activity and include the pump in preventive maintenance program.
- At the end of its service life, please dispose of pump and contents properly.

## PE01X PUMP OPERATION

- Solenoid control allows the cycle rate of the pump to be controlled electronically.  
With Solenoid control, when the solenoid is energized, the pump strokes and dispenses the fluid in one chamber. When the solenoid is de-energized, the pump strokes in the opposite direction, dispensing the fluid in the other chamber.  
By providing continuous ON - OFF signals to the solenoid, the fluid transfer rate may be increased or decreased remotely.
- End of stroke feedback can be used in conjunction with the solenoid valve to cycle the pump based upon completion of each stroke.
- The leak detection option incorporates an optical fluid sensor in each air chamber to provide a signal when a diaphragm has failed and fluid is leaking through the pump.

## PARTS LIST / PX01X-XXX-XXX-AXXX

COMMON PARTS				
PX01X-XXX-XXX-AXXX				
Item	Description	[Mtl]	Qty	Part no
1	Rod Assembly (includes seals)	---	[1]	24028284
5	Washer, Diaphragm	[P]	[2]	23981541
77	Plate	---	[2]	93264
206	Caution Label	---	[1]	93122
207	Warning Label	---	[1]	93616-1
26	Screw	[SS]	[32]	23981574

MATERIAL CODE	
[B]	= Nitrile
[Co]	= Copper
[D]	= Acetal
[E]	= E.P.R. / EPDM
[G]	= Nitrile
[GP]	= Groundable Polypropylene
[H]	= Hytrel

MATERIAL CODE	
[K]	= PVDF
[N]	= Neoprene
[P]	= Polypropylene
[Sp]	= Santoprene
[SS]	= Stainless Steel
[T]	= PTFE
[U]	= Polyurethane
[V]	= Viton

FLUID CONNECTION										
PX01X-XXX-XXX-AXXX										
		PX01X-HDS			PX01X-HKS			PX01X-HPS		
Item	Description	Part no	[Mtl]	Qty	Part no	[Mtl]	Qty	Part no	[Mtl]	Qty
6	Diaphragm Screw	93810-2	[D]	(2)	93810-3	[K]	(2)	93810-7	[P]	(2)
15	Fluid Cap	23981640	[D]	(2)	23981657	[K]	(2)	23981632	[P]	(2)
60	Inlet Manifold	23981681	[D]	(1)	23981699	[K]	(1)	23981673	[P]	(1)
61	Outlet Manifold	23981723	[D]	(1)	23981731	[K]	(1)	23981715	[P]	(1)
43	Ground Lug	93004	[Co]	(1)	---			---		

FLUID CONNECTION										
PX01X-XXX-XXX-AXXX										
		PX01X-HES			PX01X-HLS			PX01X-HRS		
Item	Description	Part no	[Mtl]	Qty	Part no	[Mtl]	Qty	Part no	[Mtl]	Qty
6	Diaphragm Screw	93810-2	[D]	(2)	93810-3	[K]	(2)	93810-7	[P]	(2)
15	Fluid Cap	23981640	[D]	(2)	23981657	[K]	(2)	23981632	[P]	(2)
60	Inlet Manifold	47516487001	[D]	(1)	47516488001	[K]	(1)	47516486001	[P]	(1)
61	Outlet Manifold	47516490001	[D]	(1)	47516491001	[K]	(1)	47516489001	[P]	(1)
43	Ground Lug	93004	[Co]	(1)	---			---		
63	Pipe Plug	93832-2	[D]	(4)	93832-3	[K]	(4)	93832-1	[P]	(4)

SEAT OPTIONS PX01X-XXX-XXX-AXXX				BALL / FLEX CHECK OPTIONS PX01X-XXX-XXX-AXXX							
"21"				"22" (5/8" OD)				"42"			
-XXX	Seat	Qty	[Mtl]	-XXX	Ball	Qty	[Mtl]	-XXX	FLEX CHECK	Qty	[Mtl]
-DXX	96580-2	(4)	[D]	-XAX	96481-A	(4)	[Sp]	-XJX	96744-2	(4)	[B]
-KXX	96580-3	(4)	[K]	-XCX	96481-C	(4)	[H]	-XNX	96744-3	(4)	[N]
-PXX	96580-1	(4)	[P]	-XGX	96481-G	(4)	[B]	-XLX	96744-4	(4)	[V]
-HPS-0XX	96745	(4)	[P]	-XTX	96481-4	(4)	[T]	-KKX	96744-1	(4)	[E]
-HKS-2XX	96745-1	(4)	[K]								
-HDS-1XX	96745-2	(4)	[D]								

DIAPHRAGM OPTIONS PX01X-XXX-XXX-AXXX												
	"3"			"7"			"19"			"64"		
-XXX	"O" Ring	Qty	Mtl	Diaphragm	Qty	Mtl	Seal	Qty	Mtl	"O" Ring	Qty	Mtl
-XXA	-----	---	---	93808	(2)	[Sp]	93761	(4)	[E]	-----	---	---
-XXC	-----	---	---	93808-C	(2)	[H]	Y325-119	(4)	[B]	-----	---	---
-XXG	-----	---	---	93808-G	(2)	[B]	Y325-119	(4)	[B]	-----	---	---
-XXT	Y327-108	(2)	[V]	93898	(2)	[T]	96514	(4)	[T]	93947	(2)	[B]

Note: Item (19) O-ring is not used with Flex Check Options.



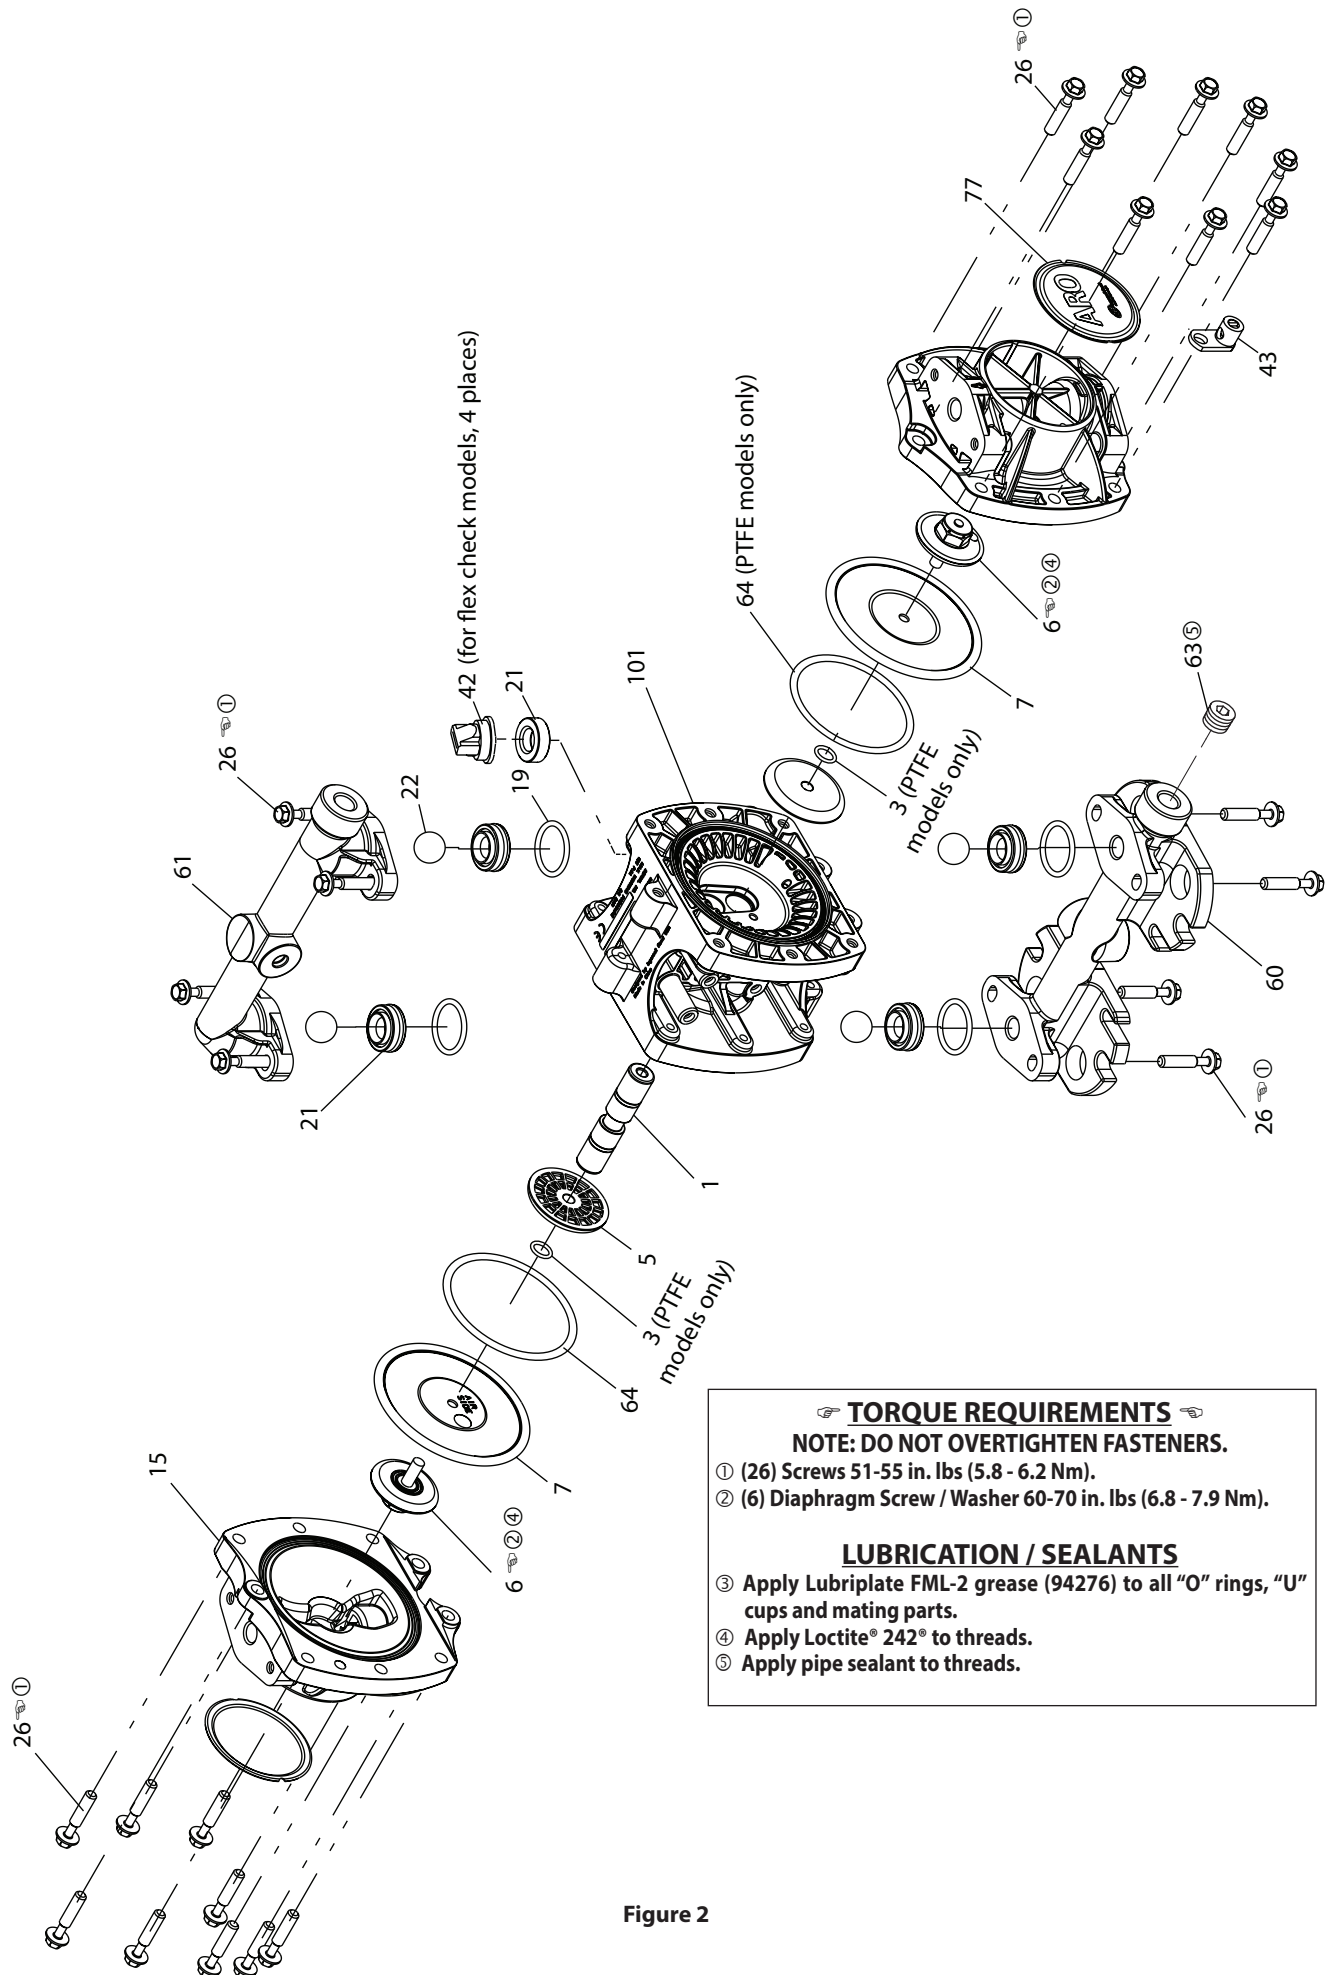


Figure 2

# PARTS LIST / PX01X-XXX-XXX-AXXX

AIR SECTION PARTS				
Item	Description	Part no	Qty	[Mtl]
74	Plug (PD01X)	93832-3	(2)	[K]
101	Center Body			
	(PX01P)	23981608	(1)	[P]
	(PX01E)	97419	(1)	[GP]
107	Valve Block Plug			
	(PD01X, PE01X-XXX-XXX-X0XX)	23981434	(1)	[P]
	(All PE01X with Solenoid)	23981848	(1)	[P]
111	Major Valve Spool Asm (includes seals)			
	(PD01X, PE01X-XXX-XXX-X0XX)	24028268	(1)	[D]
	(All PE01X with Solenoid)	24086779	(1)	[D]
129	Muffler Baffle			
	(PD01X, PE01X-XXX-XXX-XX0X), (PE01X-XXX-XXX-XX1X), (PE01X-XXX-XXX-XXMX)	23981475	(1)	[P]
	(PE01X-XXX-XXX-XXEX), (PE01X-XXX-XXX-XXFX)	24110934	(1)	[P]
	(PE01X-XXX-XXX-XXGX), (PE01X-XXX-XXX-XXHX), (PE01X-XXX-XXX-XXRX), (PE01X-XXX-XXX-XXTX)	97404	(1)	[P]
132	Gasket	23981525	(1)	[B]
135	Valve Block Assembly			
	(PD01X, PE01X-XXX-XXX-X0XX)	24243388	(1)	[P]
	(All PE01X with Solenoid)	24340275	(1)	[P]
137	O-Ring (0.070 CS x 0.676 ID)	Y325-17	(1)	[B]
167	Pilot Valve Spool Assembly (includes seals)	24028276	(1)	[D]
173	O-Ring	24243313	(1)	[U]
197	Leak Detector Sensor Adapter (PEXX-XXX-XXX-XXEX, PEXX-XXX-XXX-XXLX)	95088	(1)	
198	Leak Detector Sensor Cable (PEXX-XXX-XXX-XXEX, PEXX-XXX-XXX-XXLX)	95087	(1)	
283	Leak Detector Sensor (PE01X-XXX-XXX-XXEX), (PE01X-XXX-XXX-XXLX)	96270-1	(2)	
	Leak Detector Sensor ATEX/IECEX (PE01X-XXX-XXX-XXHX), (PE01X-XXX-XXX-XXMX)	96270-2	(2)	
	Leak Detector Sensor NEC/CEC (PE01X-XXX-XXX-XXMX), (PE01X-XXX-XXX-XXTX)	96270-2	(2)	

AIR SECTION PARTS				
Item	Description	Part no	Qty	[Mtl]
	Barrier Amplifier, End of Stroke ATEX/IECEX (PXXXX-XXX-XXX-XXGX), (PXXXX-XXX-XXX-XXHX)	97491	(1)	
	Barrier Amplifier, End of Stroke NEC/CEC (PXXXX-XXX-XXX-XXRX), (PXXXX-XXX-XXX-XXTX)	97412	(1)	
	ZENER Barrier Leak Detection ATEX (PXXXX-XXX-XXX-XXHX), (PXXXX-XXX-XXX-XXMX), (PXXXX-XXX-XXX-XXTX)	97414	(1)	
403	Valve (All PE01X with Solenoid)	114102	(1)	
413	Coil Nut (All PE01X with Solenoid)	119380	(1)	
414	Coil, 120VAC (PE01X-XXX-XXX-XAXX)	116218-33	(1)	
	Coil, 24VAC, 12VDC (PE01X-XXX-XXX-XBXX)	116218-38	(1)	
	Coil, 240VAC (PE01X-XXX-XXX-XCXX)	116218-35	(1)	
	Coil, 48VAC, 24VDC (PE01X-XXX-XXX-XDXX)	116218-39	(1)	
	Coil, ATEX/IECEX, 12VDC (PE01X-XXX-XXX-XGXX)	117345-38	(1)	
	Coil, ATEX/IECEX, 24VDC (PE01X-XXX-XXX-XHXX)	117345-39	(1)	
	Coil, ATEX/IECEX, 220VAC (PE01X-XXX-XXX-XKXX)	117345-35	(1)	
	Coil, 12VDC NEC/CEC (PE01X-XXX-XXX-XEXX)	114772-38	(1)	
	Coil, 24VDC NEC /CEC (PE01X-XXX-XXX-XFXX)	114772-39	(1)	
	Coil, 120VAC NEC/CEC (PE01X-XXX-XXX-XJXX)	114772-33	(1)	
415	O-Ring (All PE01X with Solenoid)	114103	(1)	[B]
416	O-Ring (All PE01X with Solenoid)	114104	(1)	[B]
417	Screw (All PE01X with Solenoid)	96728647	(2)	
418	Tube (All PE01X with Solenoid)	15309974	(1)	[SS]
419	Seal (All PE01X with Solenoid)	96957	(1)	[B]
420	Snap Ring (All PE01X with Solenoid)	Y147-43	(1)	
421	Retainer (All PE01X with Solenoid)	15309990	(1)	[B]
429	Solenoid Muffler (All PE01X with Solenoid)	116464	(1)	

## SOLENOID VALVE BLOCK SERVICE KIT OPTIONS

### Solenoid Valve Block Service Kit 637371 - 3 - X Valve Block Materials

3 - Black Non-Metallic

For Solenoid Option, choose letter in Specialty Code 1 from  
"MODEL DESCRIPTION CHART"

Includes items: 107, 111, 132, 135, 137, 403, 413, 414, 415, 416, 417,  
418, 419, 420, 421 and 429

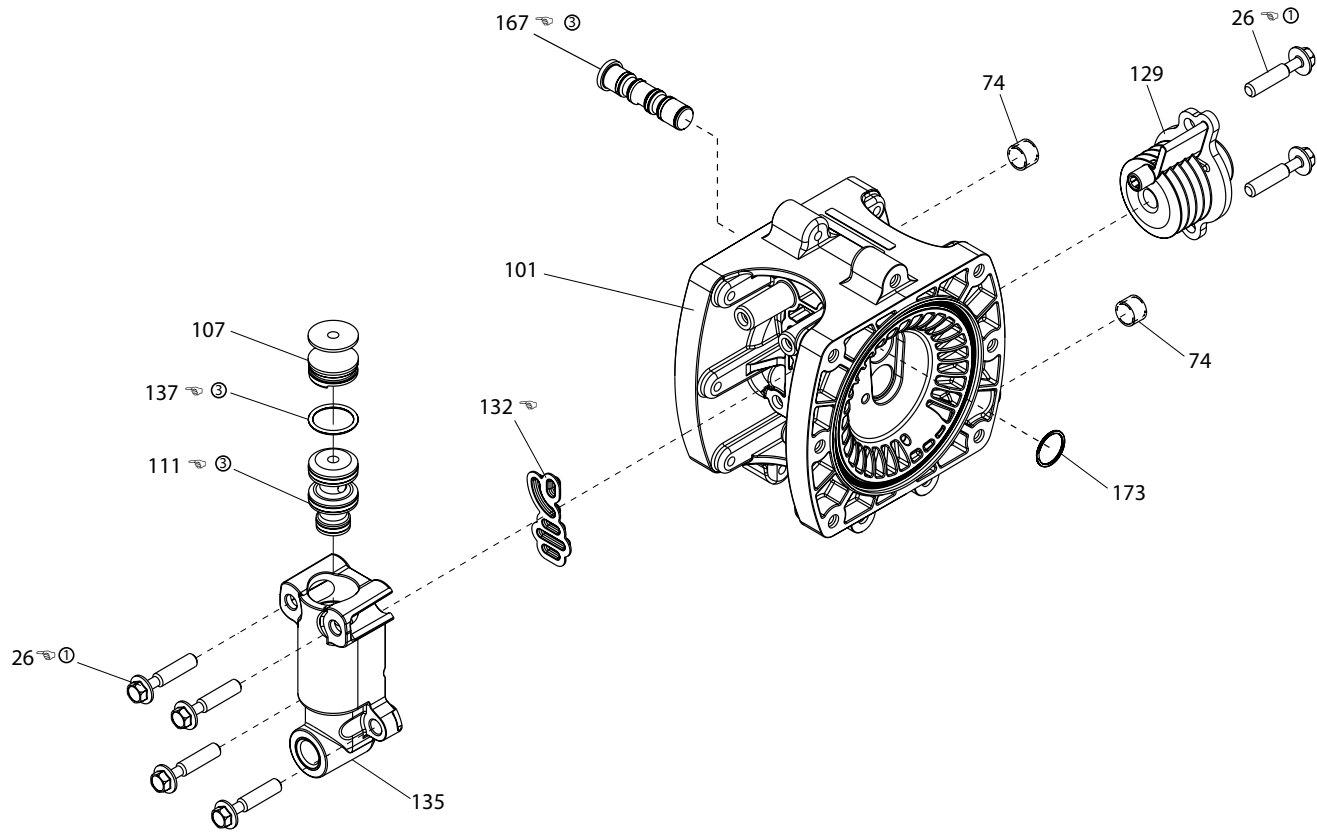


Figure 3


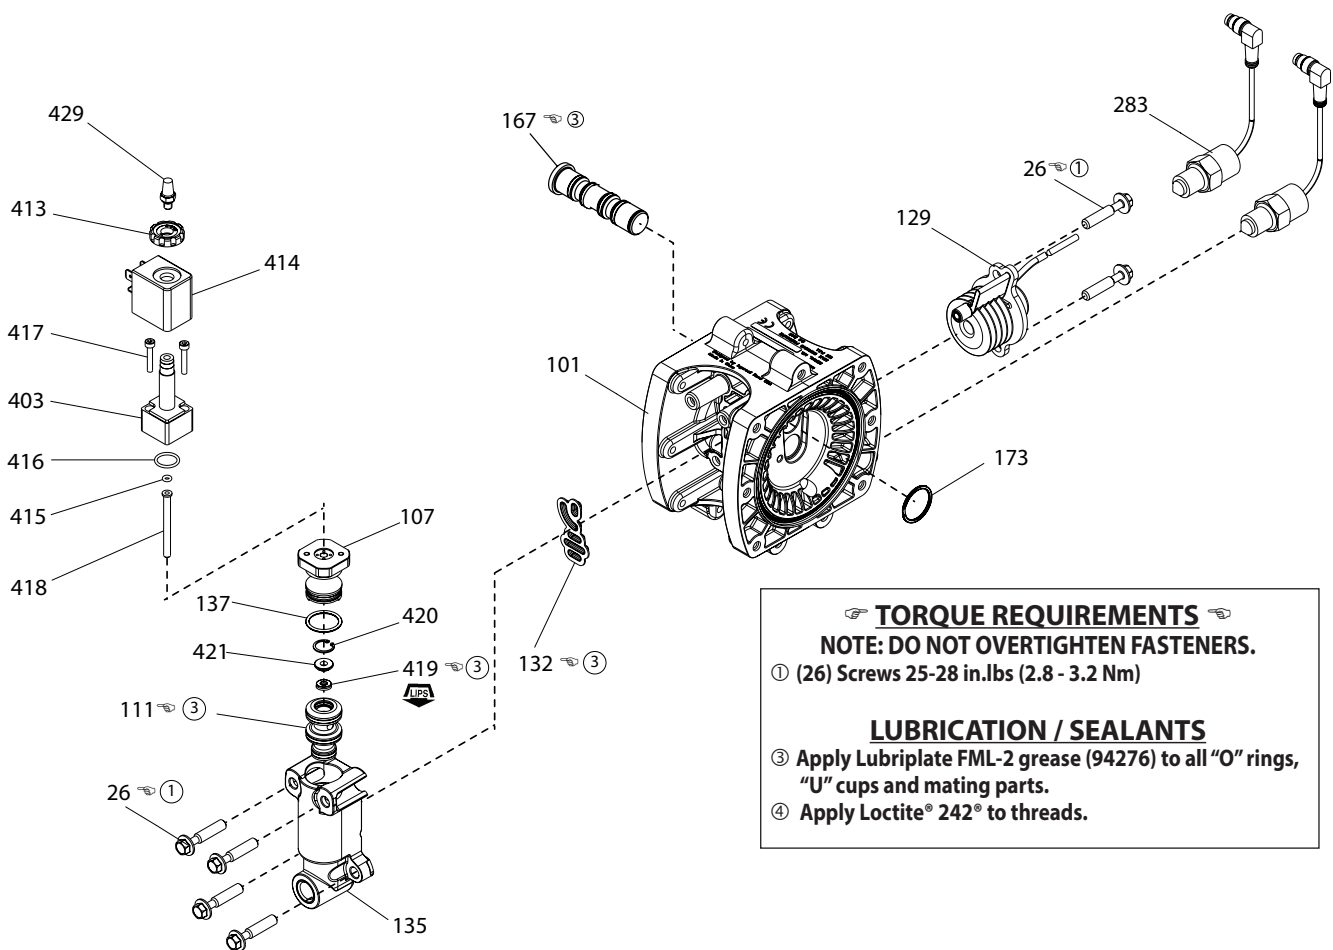


Figure 4




## Solenoid Wiring Diagram

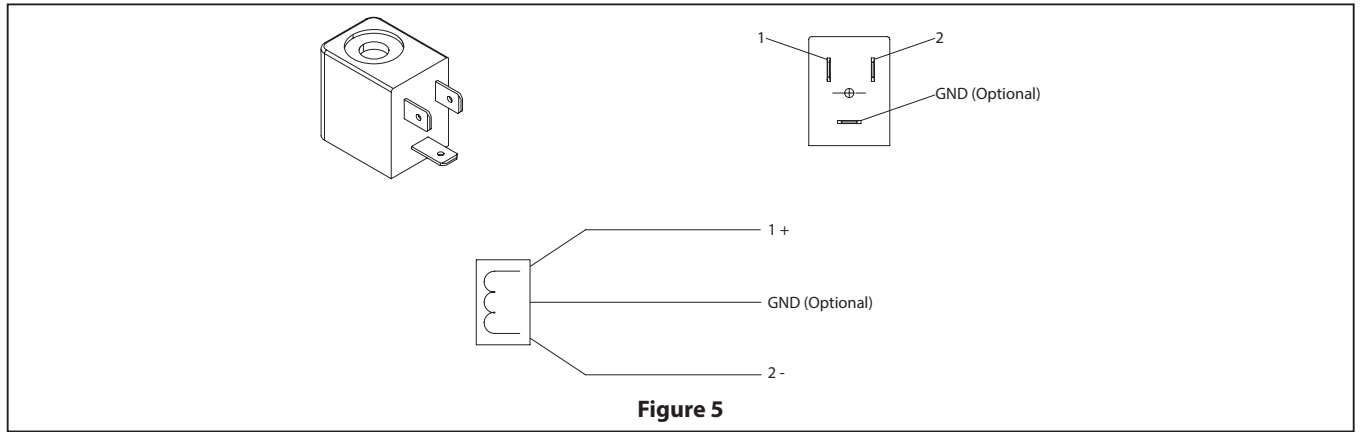


Caution: When running pump while using Electronic Interface / Solenoid Control, it is possible for air inlet pressure to exceed fluid discharge pressure. This pressure differential could cause shortened diaphragm life. Assure that appropriate inlet air pressure is being applied based on application parameters and that the supplied air is shut off and vented when the pump is not in use.


## End of Stroke / Cycle Sensor Pinout, M12 Connector

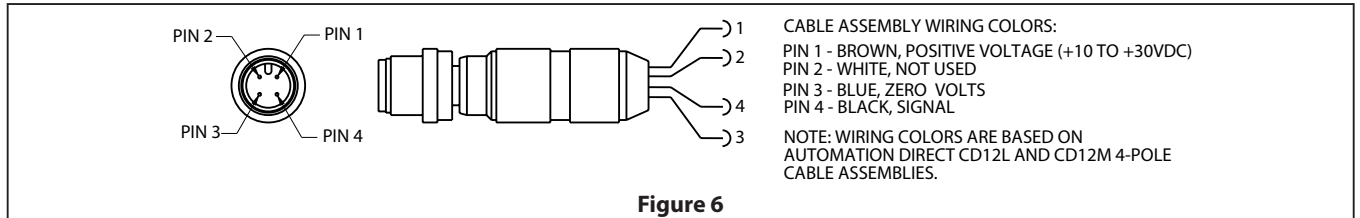

## End of Stroke / Cycle Sensor Pinout Wiring Diagram (No Connector)

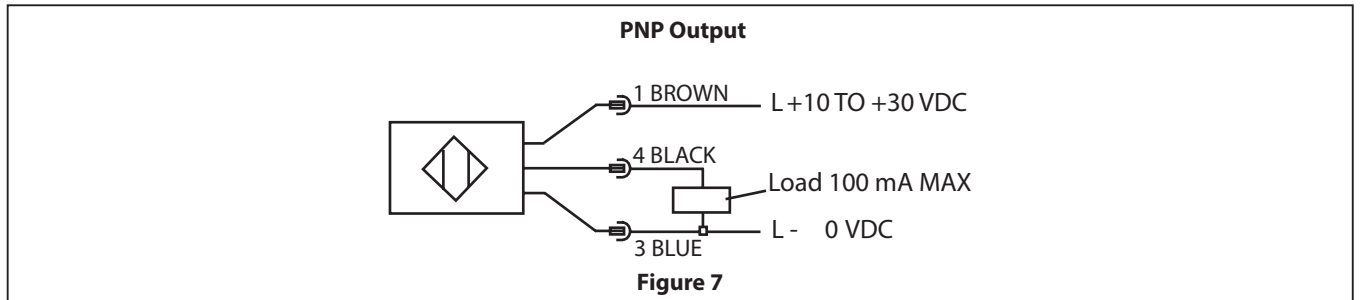

## Diaphragm Failure Detector Wiring Diagram

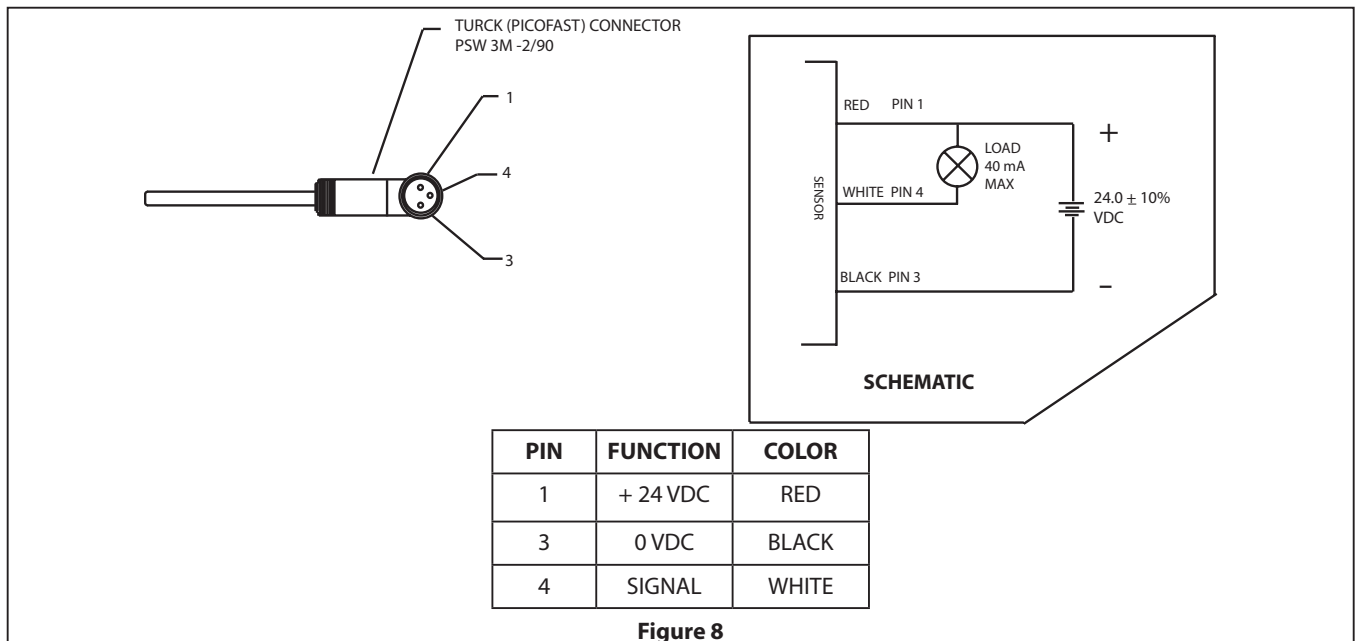

## INSTALLATION OF ELECTRONIC INTERFACE COMPONENTS FOR HAZARDOUS DUTY APPLICATIONS

Pumps that will operate in environments defined as “hazardous locations” must only be installed, connected and set-up by qualified personnel with knowledge and understanding of protection classes, regulations and provisions for apparatus in hazardous areas, for the region where the pump will operate, because these regulations and provisions, along with the definition of what constitutes hazardous areas vary by location.

Solenoid PN	Voltage	Device Rating (mA)	Temperature Rating
114772-33 (NEC / CEC)	120 VAC	57 mA	-4° F to +140° F (-20° C to +60° C)
114772-38 (NEC / CEC)	12 VDC	375 mA	-4° F to +140° F (-20° C to +60° C)
114772-39 (NEC / CEC)	24 VDC	191 mA	-4° F to +140° F (-20° C to +60° C)
117345-35 (ATEX/IECEX)	220 VAC	13 mA	-4° F to +140° F (-20° C to +60° C)
117345-38 (ATEX/IECEX)	12 VDC	267 mA	-4° F to +140° F (-20° C to +60° C)
117345-39 (ATEX/IECEX)	24 VDC	136 mA	-4° F to +140° F (-20° C to +60° C)
116218-33	120 VAC	57 mA	-4° F to +140° F (-20° C to +60° C)
116218-35	240 VAC	29 mA	-4° F to +140° F (-20° C to +60° C)
116218-38	12 VDC	450 mA	-4° F to +140° F (-20° C to +60° C)
116218-39	24 VDC	200 mA	-4° F to +140° F (-20° C to +60° C)

End of Stroke Proximity Sensor PN	Voltage	Device Rating (mA)	Temperature Rating
97398 (ATEX/IECEX/NEC/CEC)*	7.5 - 30 VDC	30 mA	-4° F to +158° F (-20° C to +70° C)
23981616	10 - 30 VDC	100 mA	-40° F to +185° F (-40° C to +85° C)

Barrier Amplifier, End of Stroke	Voltage	Device Rating (mA)	Temperature Rating
97491 (ATEX/IECEX)*	19.2 - 31.2 VDC	80 mA	-4° F to +140° F (-20° C to +60° C)
97412 (NEC/CEC)*	24 VDC	100 mA	-4° F to +140° F (-20° C to +60° C)

Zener Barrier, Leak Detection PN	Voltage	Device Rating (mA)	Temperature Rating
97414 (ATEX/IECEX/NEC/CEC)*	24 VDC	50 mA	-40° F to +140° F (-40° C to +60° C)

Leak Detector PN	Voltage	Device Rating (mA)	Temperature Rating
96270-1	24 VDC	40 mA	-0.4° F to +176° F (-18° C to +80° C)
96270-2 (ATEX/IECEX/NEC/CEC)*	24 VDC	40 mA	-0.4° F to +176° F (-18° C to +80° C)

Maximum process fluid and ambient temperatures should not to exceed 50° C.

\* Note: Intrinsically safe entity parameters for use in hazardous environments are shown on page 11.

## Intrinsically Safe Entity Parameters

Leak Detector (ATEX/IECEX/NEC/CEC)			Cable			Zener Barrier (ATEX/IECEX/NEC/CEC)			Safe Loop Calculations			
ARO Part Number 96270-2			Alpha Wire 1173C			ARO Part Number 97414			Considering 100m of cable			
Ui	32	VDC				Uo	25.2	VDC	$U_i \geq U_o$	6.8	VDC	TRUE
Ii	87	mA				Io	74	mA	$I_i \geq I_o$	13	mA	TRUE
Pi	0.616	W				Po	0.464	W	$P_i \geq P_o$	0.15	W	TRUE
Ci	0.052	uF	Cc	74.8	pF/m	Co	0.107	uF	$C_o \geq C_i + C_c$	0.05	uF	TRUE
Li	0.0037	mH	Lc	0.59	uH/m	Lo	6.492	mH	$L_o \geq L_i + L_c$	6.43	mH	TRUE
Um	250	VAC/DC				Um	250	VAC/DC				
Ta	-0.4° F to +176° F (-18° C to +80° C)					Ta	-40° F to +140° F (-40° C to +60° C)					

End of Stroke Proximity Sensor			Cable			Barrier Amplifier (ATEX/IECEX)			Safe Loop Calculations			
ARO Part Number 97398, M6.5			Recommended 22 AWG, 300V			ARO Part Number 97491			Considering 100m of cable			
Ui	15	VDC				Uo	10.6	VDC	$U_i \geq U_o$	4.4	VDC	TRUE
Ii	50	mA				Io	12	mA	$I_i \geq I_o$	38	mA	TRUE
Pi	0.12	W				Po	0.032	W	$P_i \geq P_o$	0.09	W	TRUE
Ci	0.008	uF	Cc	140	pF/m	Co	2	uF	$C_o \geq C_i + C_c$	1.98	uF	TRUE
Li	0.007	mH	Lc	0.6	uH/m	Lo	260	mH	$L_o \geq L_i + L_c$	259.9	mH	TRUE
Ta	-4° F to +176° F (-20° C to +80° C)					Um	253	VAC/DC				
Ta	-4° F to +158° F (-20° C to +70° C)					Ta	-4° F to +140° F (-20° C to +60° C)					

End of Stroke Proximity Sensor			Cable			Barrier Amplifier (NEC/CEC)			Safe Loop Calculations			
ARO Part Number 97398, M6.5			Recommended 22 AWG, 300V			ARO Part Number 97412			Considering 100m of cable			
Ui	15	VDC				Uo	10.5	VDC	$U_i \geq U_o$	4.5	VDC	TRUE
Ii	50	mA				Io	13	mA	$I_i \geq I_o$	37	mA	TRUE
Pi	0.12	W				Po	0.034	W	$P_i \geq P_o$	0.1	W	TRUE
Ci	0.008	uF	Cc	140	pF/m	Co	2.66	uF	$C_o \geq C_i + C_c$	2.64	uF	TRUE
Li	0.007	mH	Lc	0.6	uH/m	Lo	192	mH	$L_o \geq L_i + L_c$	191.9	mH	TRUE
Ta	-4° F to +176° F (-20° C to +80° C)					Um	60	VAC/DC				
Ta	-4° F to +158° F (-20° C to +70° C)					Ta	-4° F to +140° F (-20° C to +60° C)					

LEAK DETECTION SENSORS


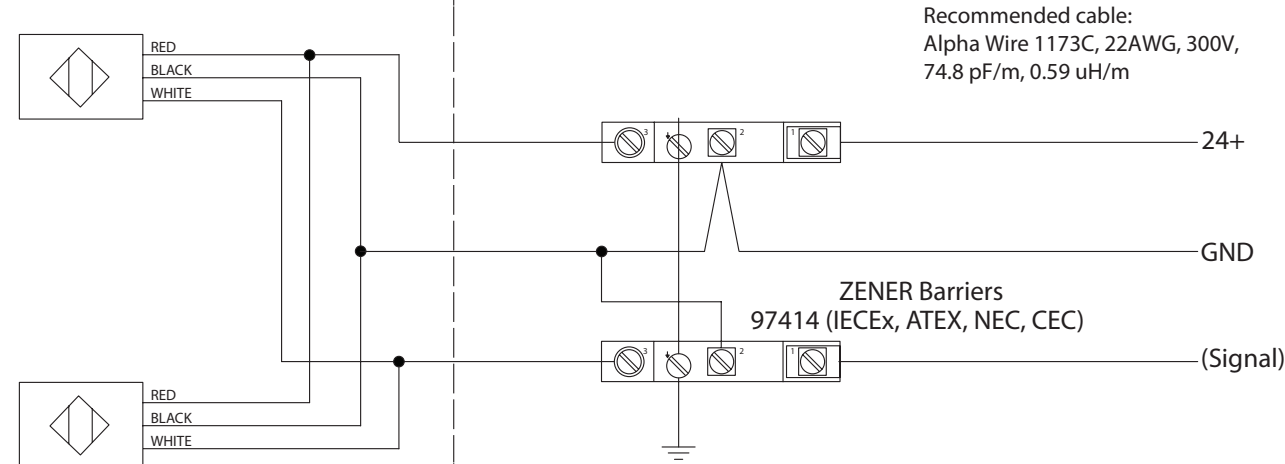


Figure 9




**NOTE:** The installers are responsible for extending the cables and taking them outside the hazardous area using approved methods and components.

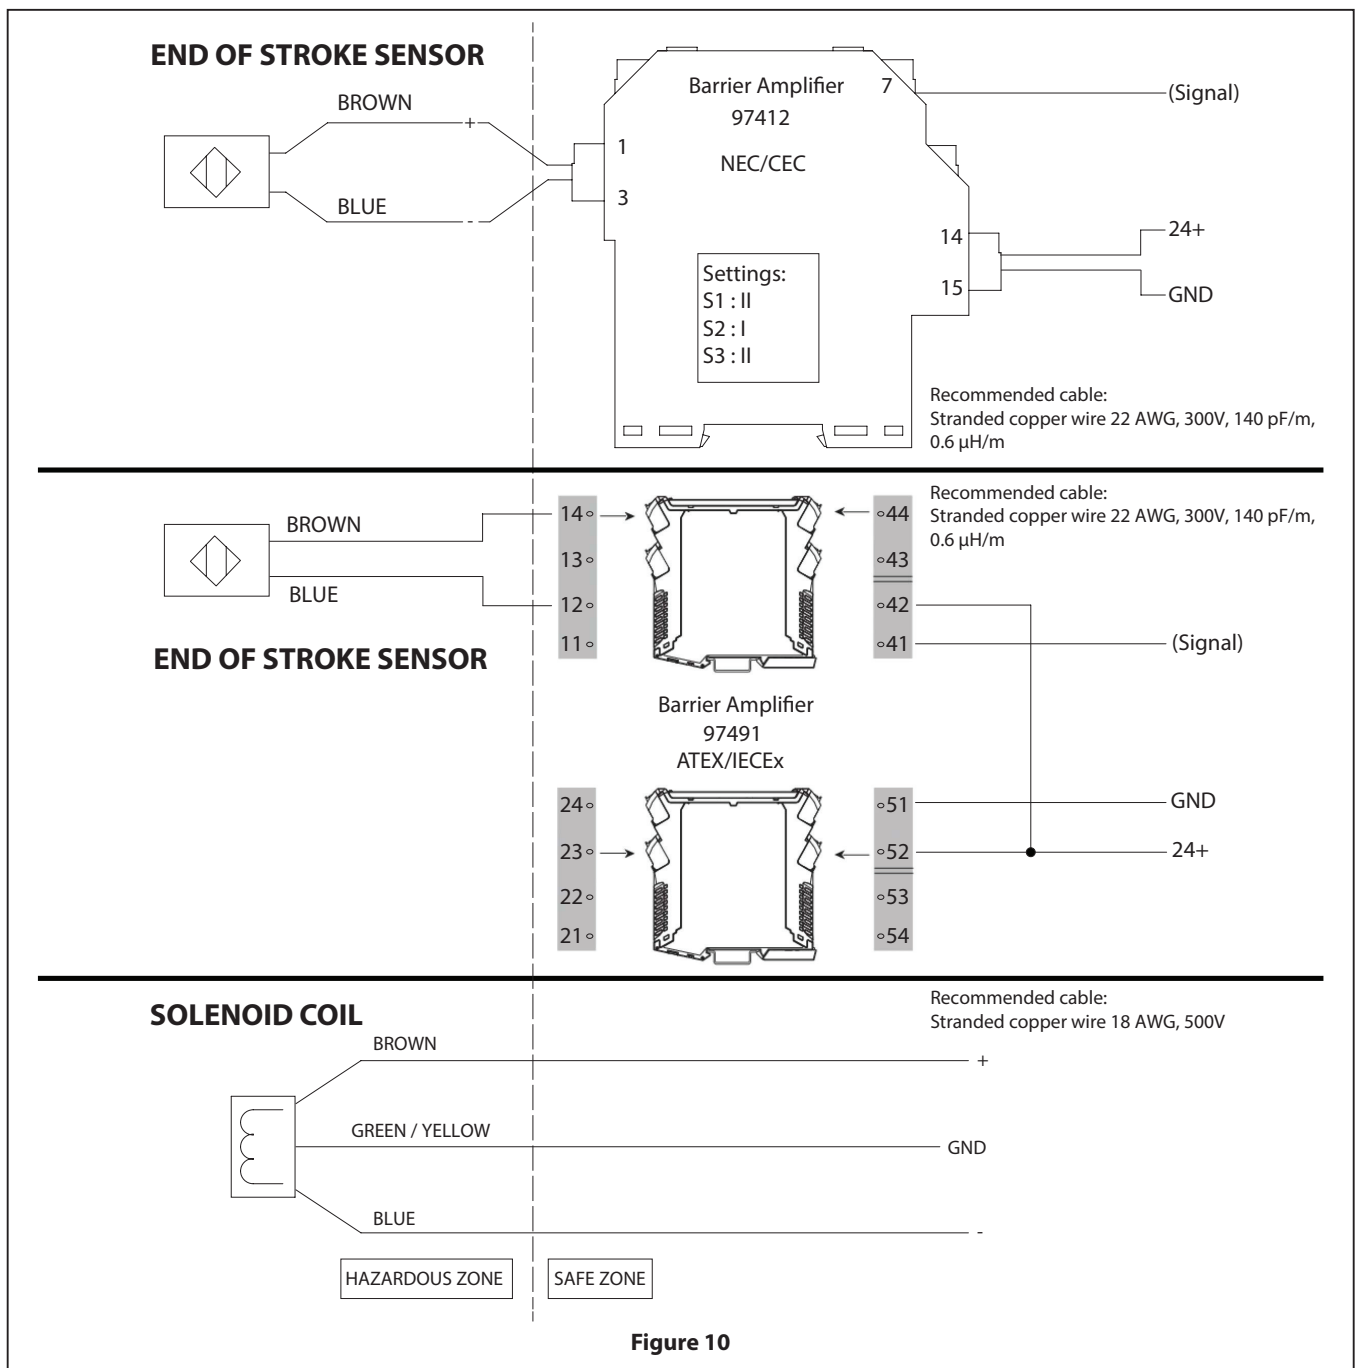

## DIMENSIONAL DATA

Dimensions shown are for reference only, they are displayed in inches and millimeters (mm).

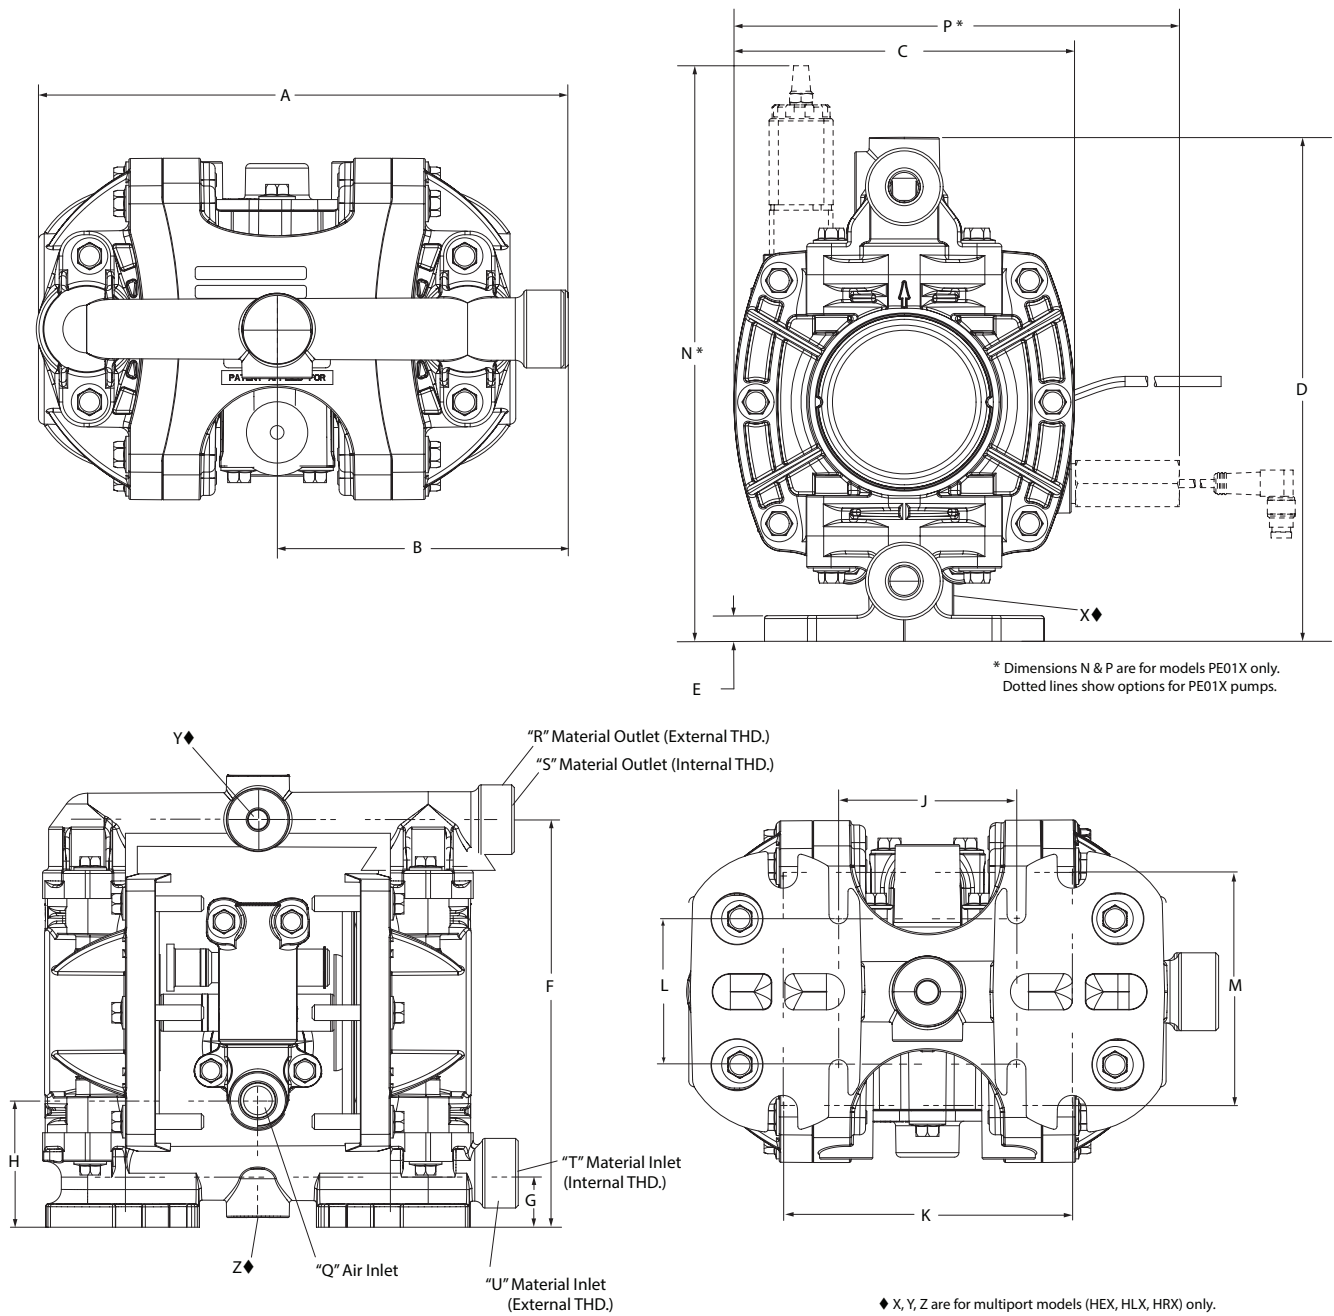

**Figure 11**

### DIMENSIONS

A - 7.2" (182 mm)	H - 1.9" (48.6 mm)	Q - 1/4 - 18 PTF SAE Short	Z - 1/4 - 18 PTF SAE Short
B - 3.9" (100.0 mm)	J - 2.4" (61 mm)	R - 3/4-14 NPTF	
C - 4.6" (117.0 mm)	K - 3.9" (99 mm)	S - 1/4 NPTF / BSPT Hybrid ▲	
D - 6.8" (173.0 mm)	L - 2.1" (53 mm)	T - 1/4 NPTF / BSPT Hybrid ▲	
E - 0.3" (8.8 mm)	M - 3.2" (81 mm)	U - 3/4-14 NPTF	
F - 6.1" (156 mm)	N - 7.2" (184 mm)	X - 1/4-18 NPTF / BSPT Hybrid	
G - 0.8" (20.7 mm)	P - 6.0" (153 mm)	Y - 1/4 NPTF / BSPT Hybrid	



