




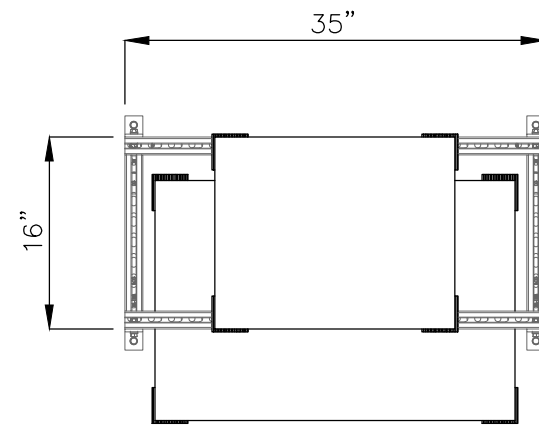

PLAN VIEW

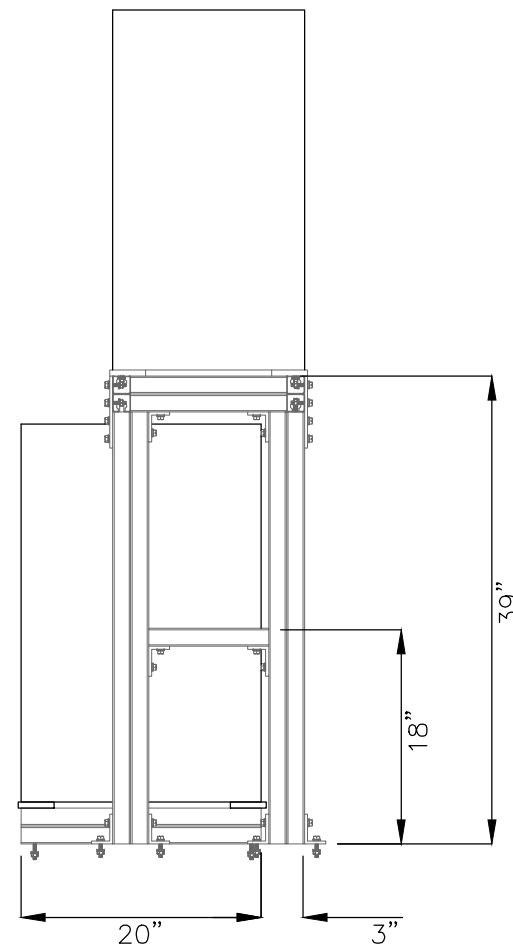

SIDE VIEW

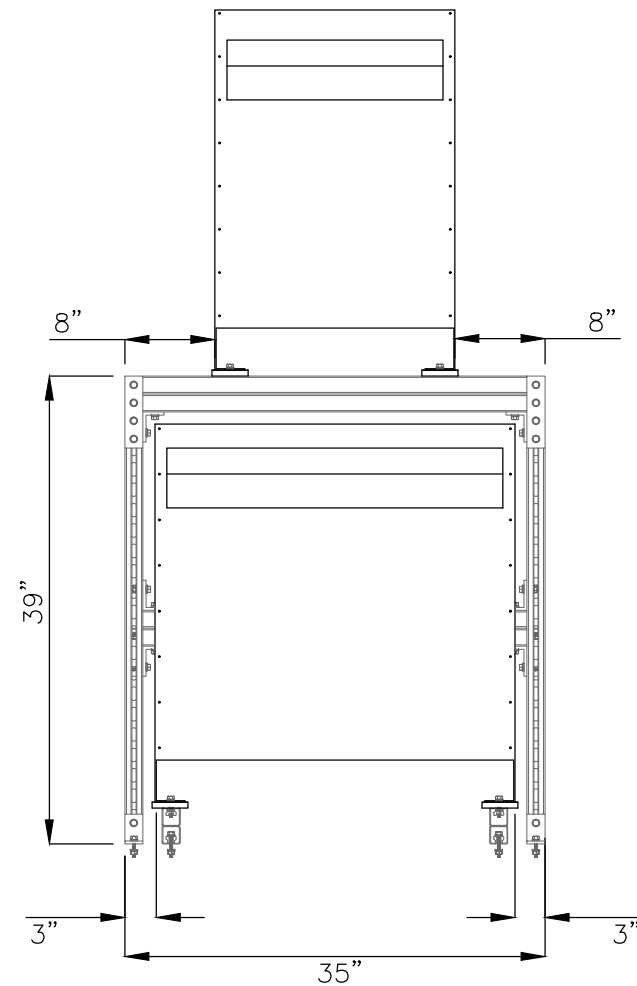

FRONT VIEW

3/4" THICK MIN.  
ANTI-VIBRATION  
PAD (TYPICAL)

6"x1-5/8" GALV. STEEL  
BRACKET W/4 HOLES  
1/4" DIA. FOR 1/4"  
BOLTS (TYPICAL)

TRANSFORMER (TR-7)  
75KVA

3/4" THICK MIN.  
ANTI-VIBRATION  
PAD (TYPICAL)

DOUBLE UNISTRUT  
1-5/8"x1-5/8"  
XFMR BASE  
(TYPICAL)

TRANSFORMER (TR-6)  
30KVA

DOUBLE UNISTRUT  
1-5/8"x1-5/8"

DOUBLE UNISTRUT  
1-5/8"x1-5/8"

(2) 1/2"x3/4"x1-5/8" GALV.  
STEEL BRACKET W/2 HOLES  
1/2" DIA. FOR 1/2" ANCHOR  
BOLTS (TYPICAL)

DIA. 1/2" HD ANCHOR  
BOLTS (TYPICAL)

NOTES:

- A. TRANSFORMER SUPPORTS SHALL BE SIZED AS  
REQUIRED. MAINTAIN ALL CODE REQUIRED CLEARANCE  
AND MANUFACTURES SPECIFICATIONS.



TRANSFORMER STACKING

|                      |             |
|----------------------|-------------|
| REV. NO. 001         | DWG. NO.    |
| REV. DATE : 09-10-20 | ELD-007     |
| DRAWN BY : R Montoya | SCALE : NTS |