

PROPOSED PROJECT FEATURES


- Pumped Storage Site
- Switchyard
- 2 - 500kV Transmission Lines

North Alternatives
(2 Parallel 500 kV Transmission Lines)

- 2 - 500 kV Lines - Option 1
- 2 - 500 kV Lines - Option 2
- 2 - 500 kV Lines - Option 3

South Alternatives
(500 kV Transmission Line)

- 500 kV Line - Option A
- 500 kV Line - Option B
- 500 kV Line - Option C

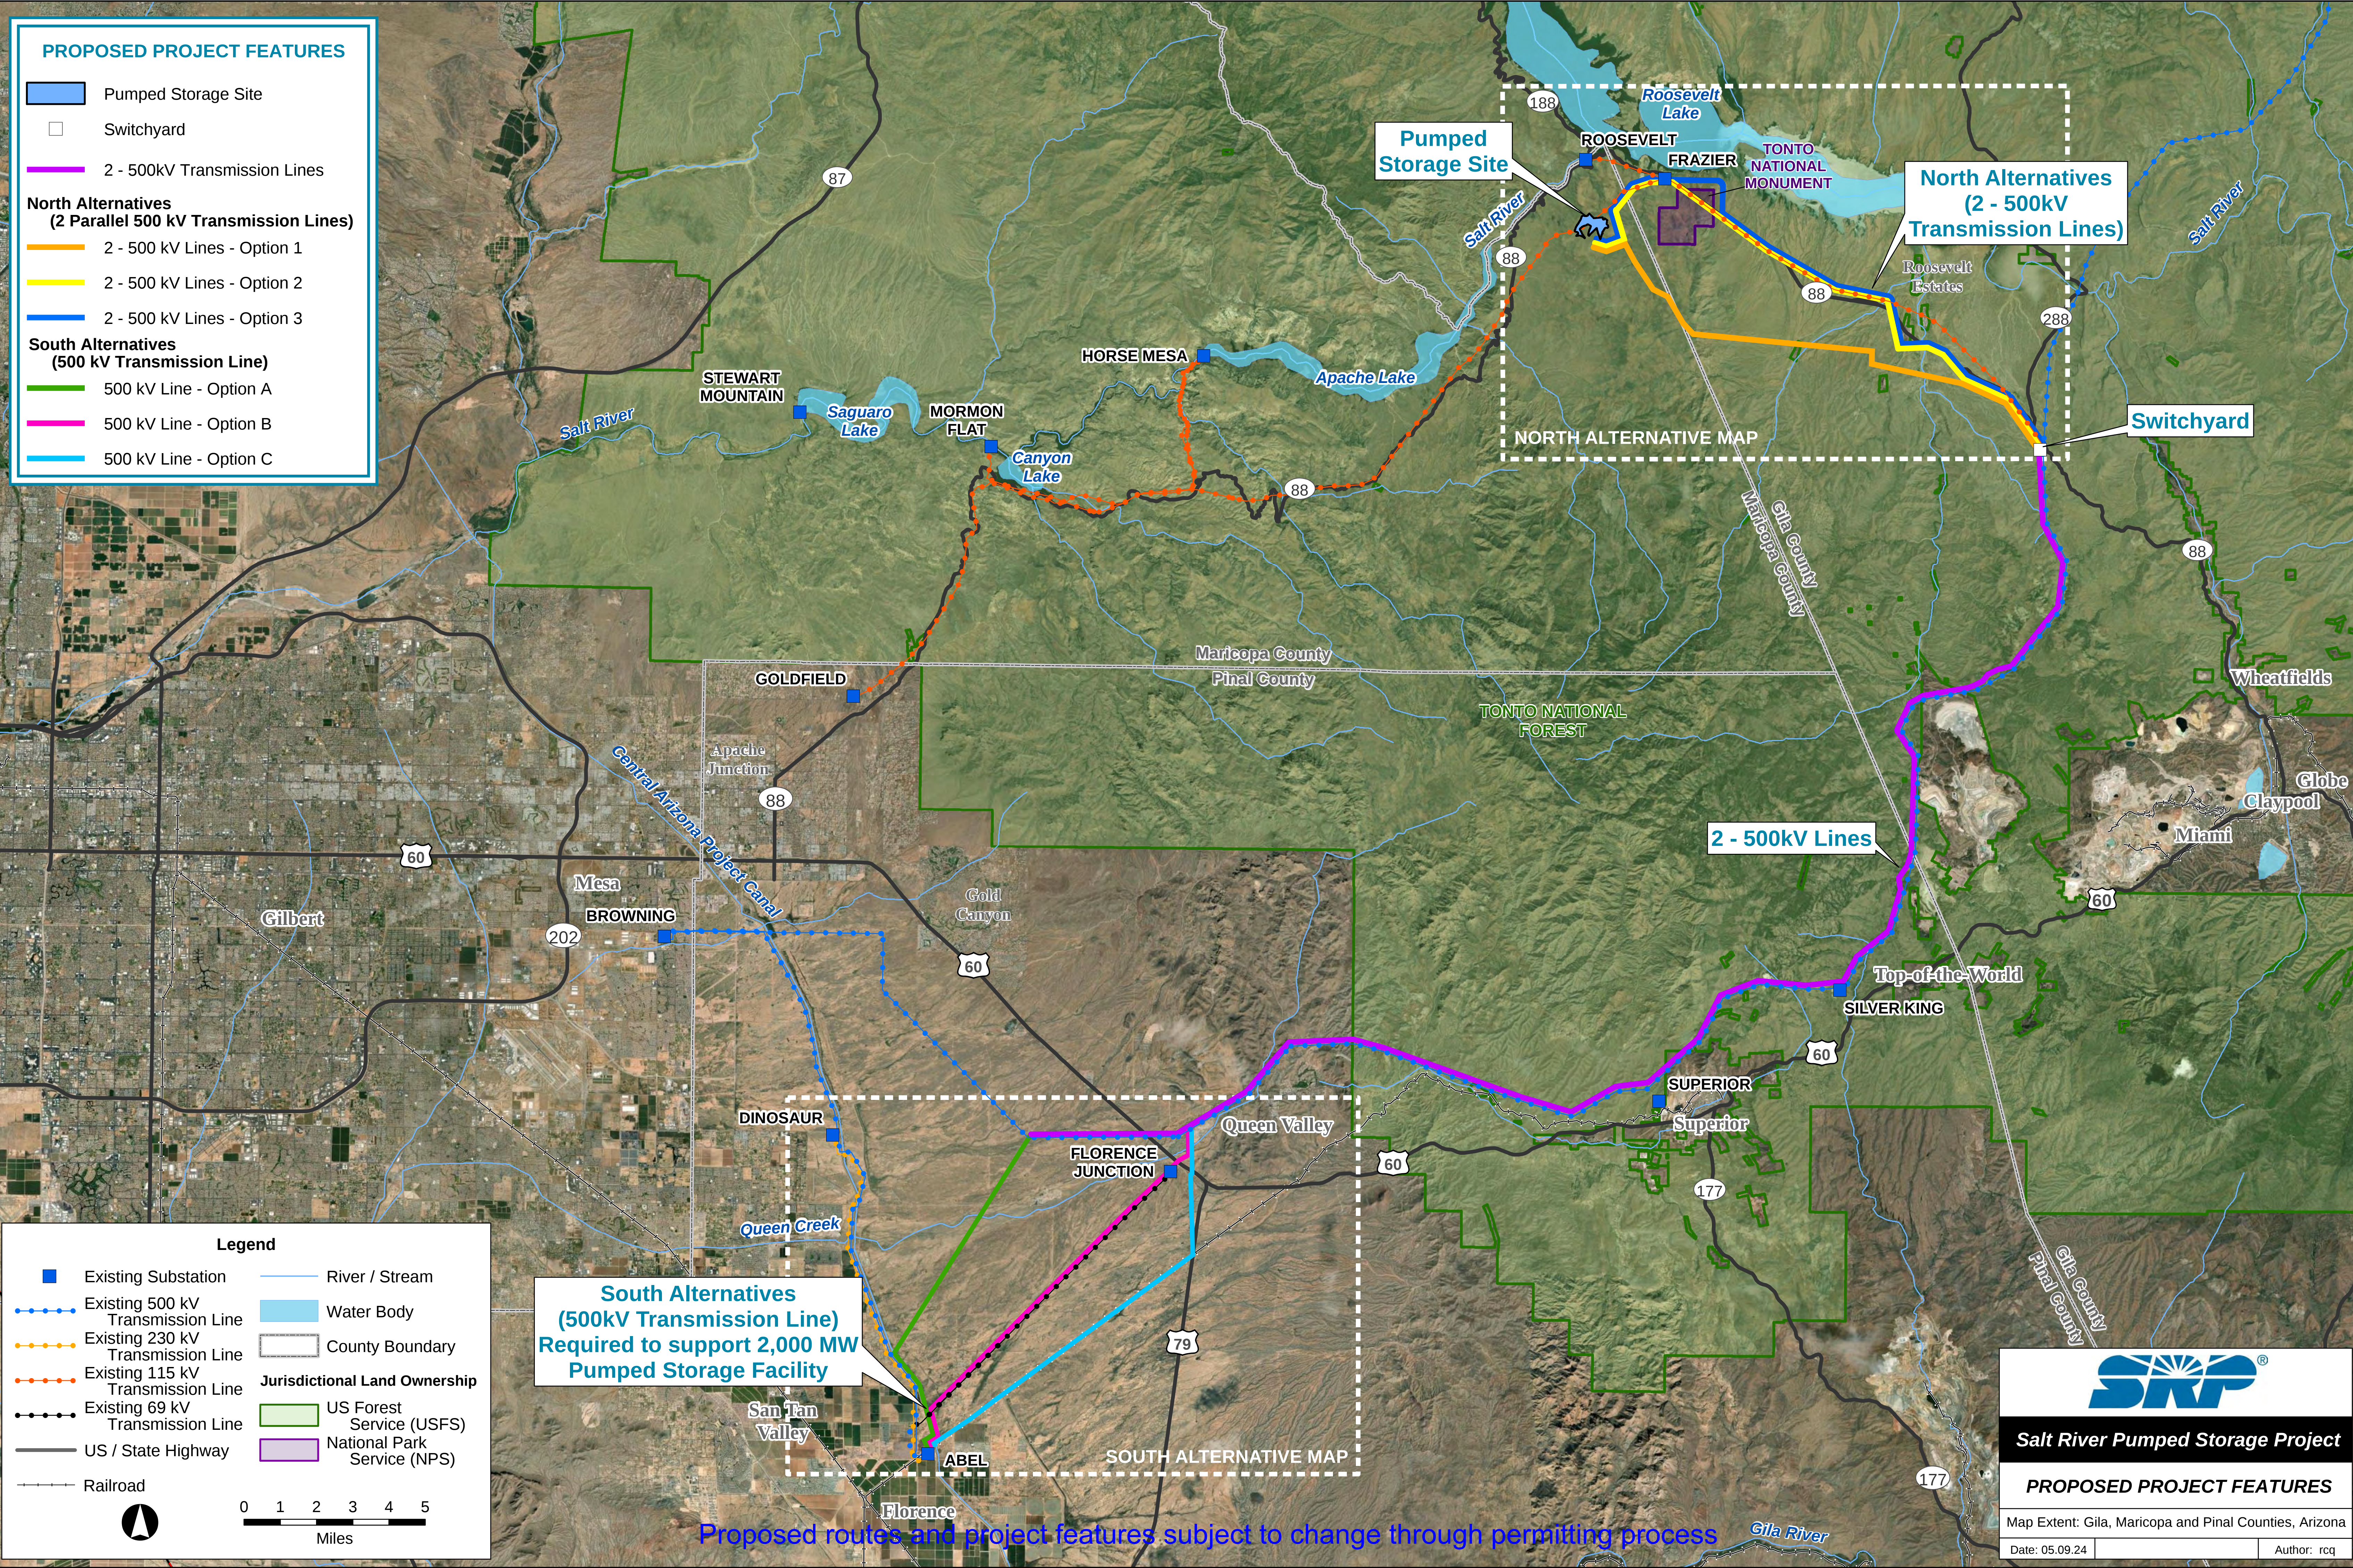

South Alternatives
(500kV Transmission Line)
Required to support 2,000 MW
Pumped Storage Facility



Salt River Pumped Storage Project

PROPOSED PROJECT FEATURES

Map Extent: Gila, Maricopa and Pinal Counties, Arizona

Date: 05.09.24

Author: rcq




Salt River Pumped Storage Project

North Transmission Alternatives

Map Extent: Gila, Maricopa and Pinal Counties, Arizona

Date: 05.09.24

Author: rcq

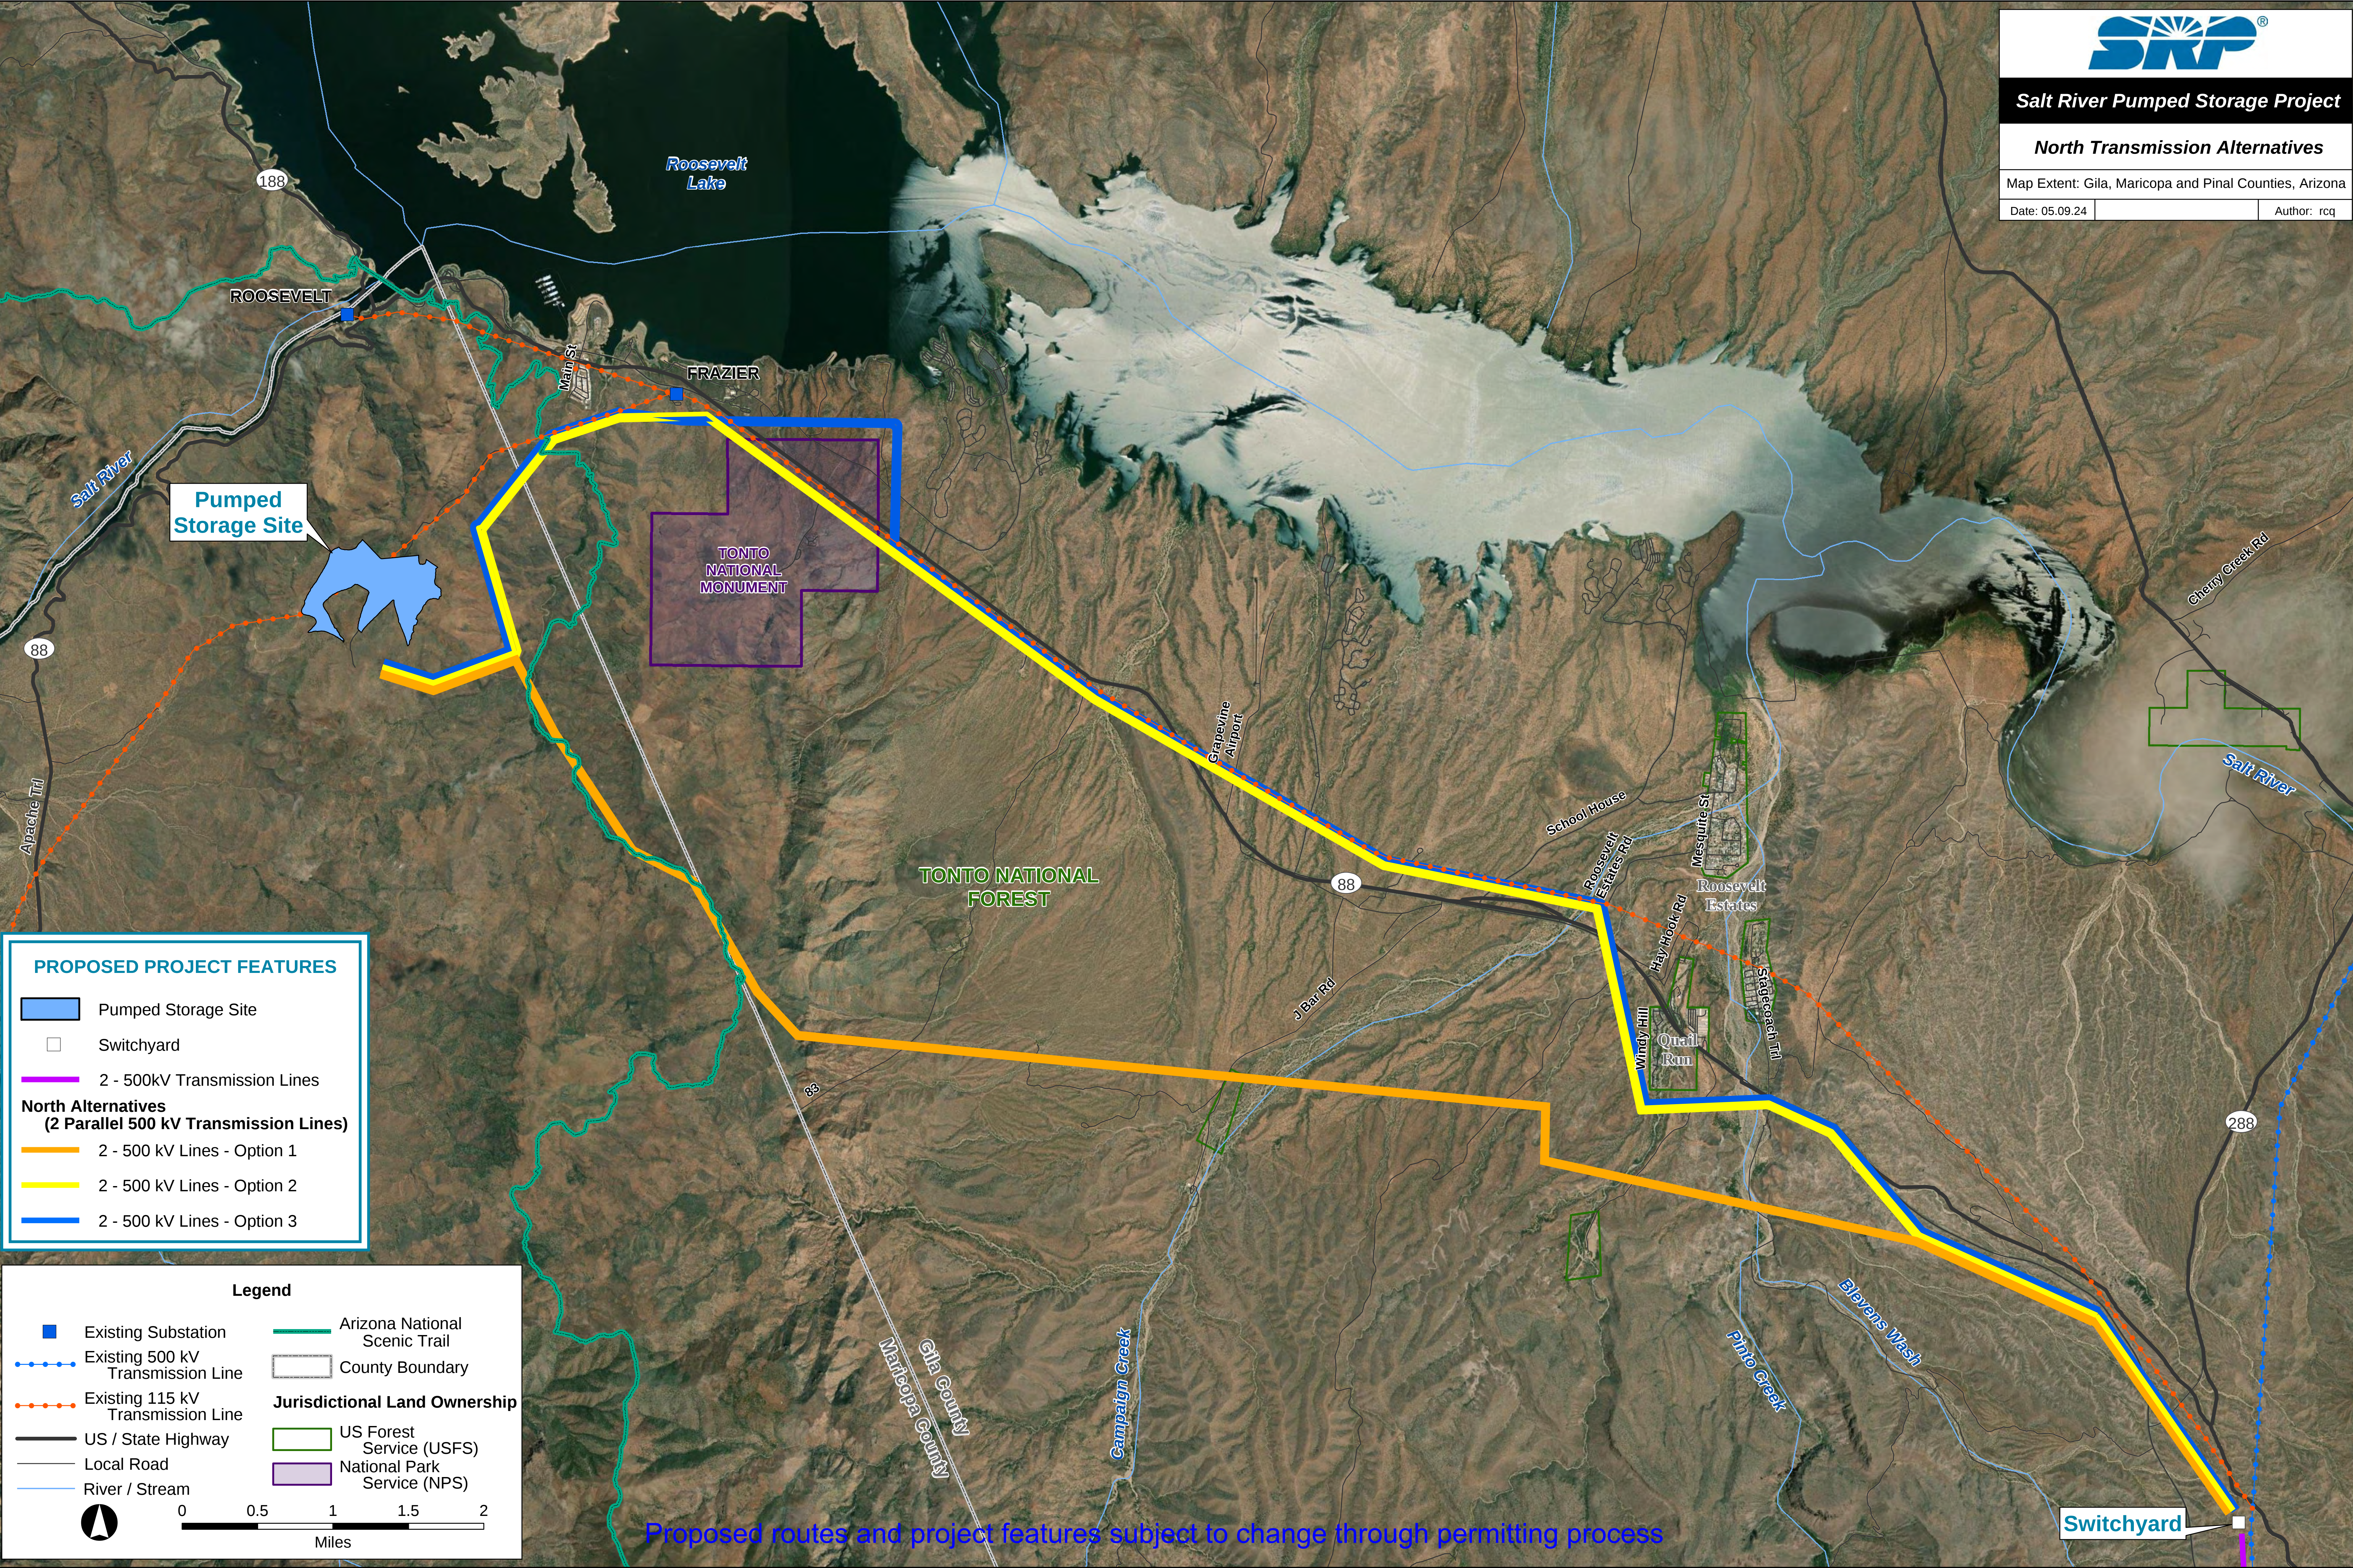

PROPOSED PROJECT FEATURES

- Pumped Storage Site
- Switchyard
- 2 - 500kV Transmission Lines

**North Alternatives
(2 Parallel 500 kV Transmission Lines)**

- 2 - 500 kV Lines - Option 1
- 2 - 500 kV Lines - Option 2
- 2 - 500 kV Lines - Option 3

Legend

- Existing Substation
- Existing 500 kV Transmission Line
- Existing 115 kV Transmission Line
- US / State Highway
- Local Road
- River / Stream

- Arizona National Scenic Trail
- County Boundary
- US Forest Service (USFS)
- National Park Service (NPS)

Jurisdictional Land Ownership

- US Forest Service (USFS)
- National Park Service (NPS)

0 0.5 1 1.5 2
Miles

Proposed routes and project features subject to change through permitting process



Salt River Pumped Storage Project

South Transmission Alternatives

Map Extent: Gila, Maricopa and Pinal Counties, Arizona

Date: 05.09.24

Author: rcq

PROPOSED PROJECT FEATURES

2 - 500kV Transmission Lines

South Alternatives
(500 kV Transmission Line)

500 kV Line - Option A

500 kV Line - Option B

500 kV Line - Option C

Legend

- Existing Substation
- Existing 500 kV Transmission Line
- Existing 230 kV Transmission Line
- Existing 69 kV Transmission Line
- US / State Highway
- Local Road
- Railroad
- River / Stream
- County Boundary



0 1 2
Miles

Transmission line alternatives
required to support 2,000 MW
Pumped Storage Facility

Proposed routes and project features subject to change through permitting process