




NOTES:

1. PROVIDE GROUND ENHANCEMENT MATERIAL, ERITECH GEM OR EQUIVALENT.
2. PROVIDE MINIMUM 12" DIAMETER BY 12' DEEP CORED HOLE FOR EACH GROUND ROD. IF BED ROCK IS ENCOUNTERED, IT IS ACCEPTABLE TO RUN THE GROUND ROD HORIZONTAL. MAINTAIN AS MUCH VERTICAL SECTION AS POSSIBLE.
3. PROVIDE GEM MATERIAL AROUND GROUND RODS. PROVIDE AT LEAST 12" OF GEM BACKFILL AROUND ALL UNDERGROUND CABLES.

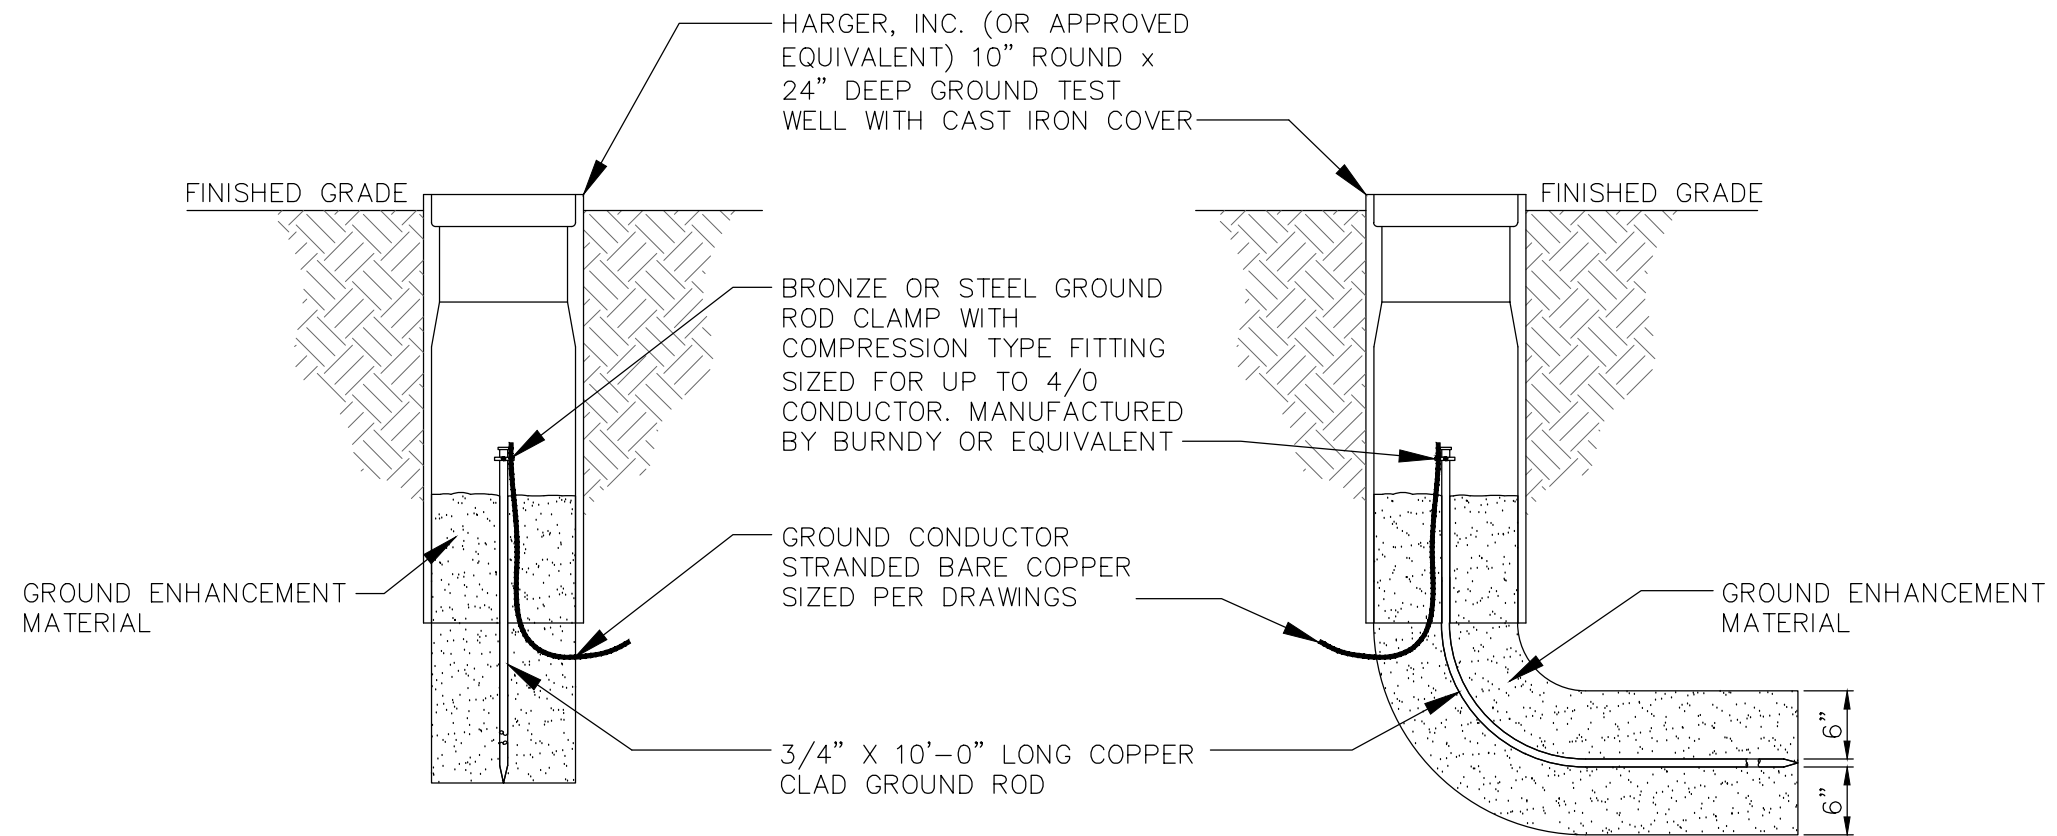

GROUND TEST WELL

REV. NO. 001	DWG. NO.
REV. DATE : 09-02-20	ELD-005
DRAWN BY : R Montoya	SCALE : NTS